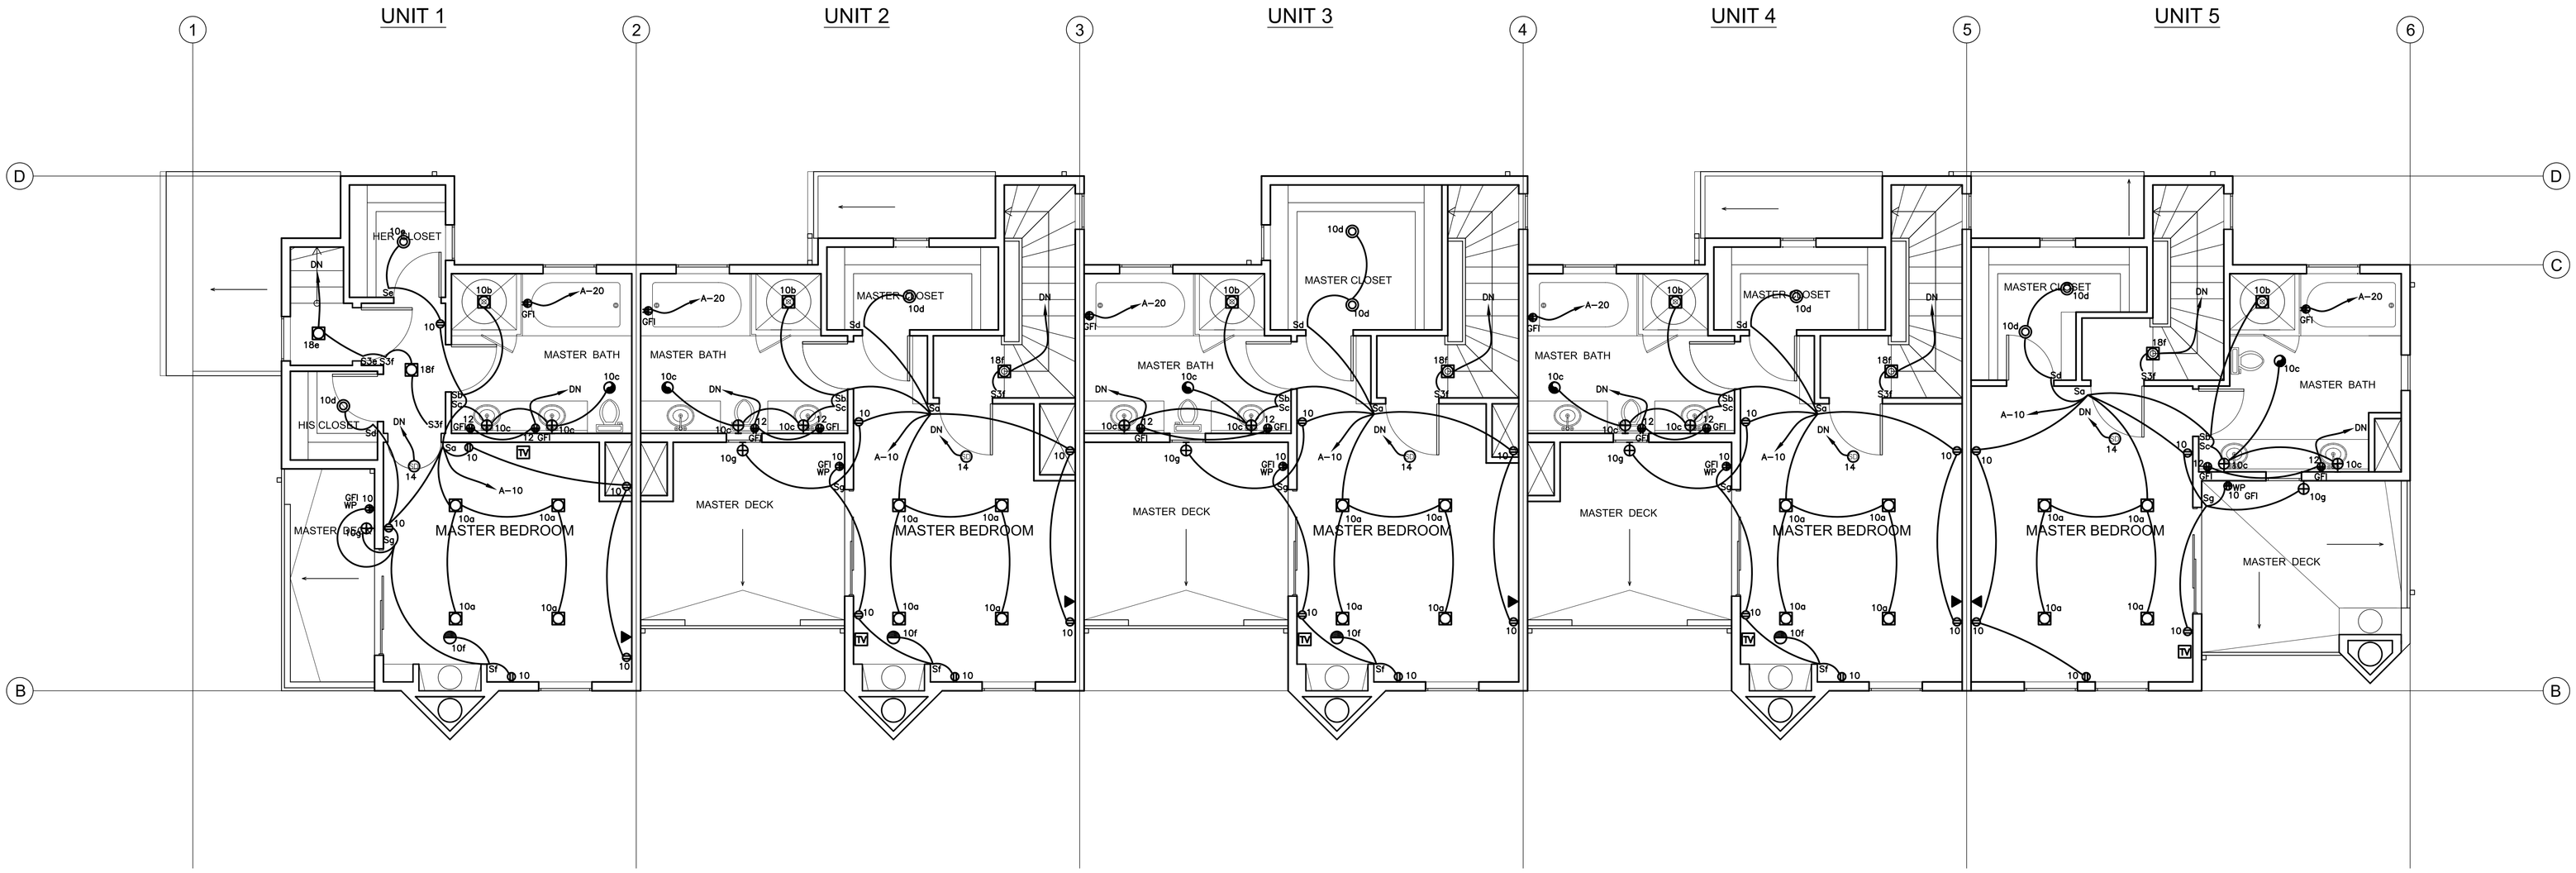

UNIT NOTES:

1. EQUIP ALL PORCHES AND BALCONIES WITH A HIGH EFFICACY LAMP WHERE APPLICABLE.
2. PROVIDE ONE OUTDOOR GFE OUTLET PER UNIT WHERE APPLICABLE.
3. LOCATE THE FAU PER MECH. ENGINEER INSTRUCTIONS IF A FAU IS SPECIFIED.
4. EQUIP THE LUMINARIES IN KITCHENS WITH HIGH EFFICACY LAMPS. SEE TABLE BELOW.
5. ALL BATHROOM FIXTURES SHALL BE EQUIPPED WITH A HIGH EFFICACY LAMP OR SHALL BE CONTROLLED BY AN OCCUPACY SENSOR.
6. ALL FIXTURES IN HALLWAYS LIVING ROOM, DINING ROOM SHALL EITHER BE EQUIPPED WITH A HIGH EFFICACY LAMP OR THE FIXTURES SHALL BE CONTROLLED BY A DIMMER SWITCH.

HIGH EFFICACY LAMPS	
LAMP POWER	REQUIRED LAMP EFFICACY
< 15 W	40 lm/W
15-40 W	5O lm/W
>40 W	6O lm/W

NOTE: THE WATTAGE OF THE BALLAST IS NOT INCLUDED WHEN DETERMINING LAMP EFFICACY

MERCURY VAPOR LAMPS DO NOT USUALLY MEET THE REQUIREMENTS; METAL HALIDE OR COMPACT FLUORESCENT LAMPS (CFLs) ARE GOOD REPLACEMENTS. FOR OTHER LAMP TYPES SUCH AS LEDs YOU SHOULD CHECK WITH THE LAMP MANUFACTURER AND PROVIDE DOCUMENTS SHOWING THAT THE LAMP MEETS THE REQUIREMENTS.

ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED OR REPRESENTED BY THIS DRAWING ARE OWNED BY ABRARI AND ASSOCIATES AND WERE CREATED AN DEVELOPED FOR USE AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF THE IDEAS, DESIGNS, ARRANGEMENTS OR PLANS SHALL BE USED BY OR DISCLOSED TO FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN AUTHORIZATION OF ABRARI AND ASSOCIATES INC.

REVISION
B

L&V ARCHITECTS
1514 17th Street, Suite 207
Santa Monica, CA 90404
Tel. (310) 829 0996; Fax. (310) 829 7889

ABRARI + ASSOCIATES
ELECTRICAL ENGINEERS
1618 BEN LOMOND DR.
GLENDALE, CA 91202
TEL. 818.507.0088 FAX 818.241.4866
CEL. 818.497.0330
MAIL@ABRARI.COM
ABRARI + ASSOCIATES

DEVELOPER
MR. ALI MADANI &
MR.HOSSEIN ASHTIANI
1327 EUCLID ST.,
SANTA MONICA, CA 90404

PROJECT
5 UNIT CONDOMINIUMS
1327 EUCLID ST.,
SANTA MONICA, CA 90404

REGISTERED PROFESSIONAL ENGINEER
HAMID R. ABRARI
NO. 13294
EXP. 3-30-06
ELECTRICAL
STATE OF CALIFORNIA

SHEET TITLE
3RD. FLR.
ELECTRICAL
PLAN

PROJECT No.:	6-362
SCALE:	1/4"=1'-0"
DATE:	11-01-2006
BY:	BB
CHECKED:	HRA

DRAWING NO.
E-7.0